



SPECIFICATIONS

AIRFLOW

2000cfm (940 L/s) at 1.0" wg ESP.

PERFORMANCE

65% effective at 2000 cfm (940 L/s).

CORES

Eight patented aluminum heat recovery cores arranged for efficient cross-flow ventilation.

MOTORS

Two ODP, 2.0 hp, 1 ph, single speed, single shaft, 240 Vac, 9.0 Amps (18.0 total) MCA: 22.5 MOP: 30

BLOWERS

Two belt drive centrifugal blowers with adjustable pulleys, one per airstream.

FILTERS

Two - 16" x 25" x 2" (406 mm x 635 mm x 50 mm) pleated filters in each airstream. MERV 6 efficiency 60% @ 4.69 microns.

CONNECTION DUCT SIZES

Four 18" x 22" (457 mm x 558 mm)

CABINET

20 gauge powder coated steel for superior corrosion resistance. Unit includes metal lined sides and roof panels with 2" fiberglass insulation (R8) between linings.

DRAIN

Two powder coated galvanized steel drain pans with 1/2" (12 mm) O.D. drain connections.

MOUNTING

Unit to be set on support brackets hung by threaded rod type apparatus. Brackets and rod not included.


ELECTRONICS

Integrated microprocessor circuit board.

CONTROL OPTION

99-DH01 Lifebreath Dehumidistat

- Humidity control through adjustable Dehumidistat
- 3 wire connection; 20 gauge wire (minimum)

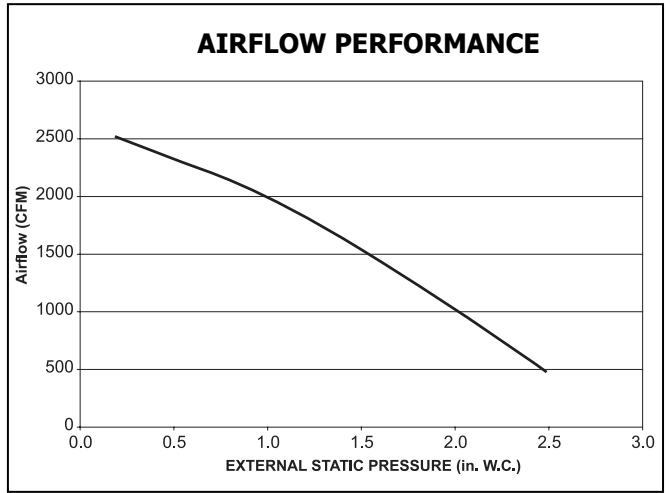

DEFROST

Factory set defrost time. Supply motor is shut off while exhaust air defrosts core.

WEIGHT 740 lbs (330 kg) **SHIPPING WEIGHT** 870 lbs (390 kg)

TIMER OPTION

99-DET01 Lifebreath 20/40/60 Minute Timer


- Initiates high speed Ventilation for 20, 40 or 60 minutes
- 3 wire connection; 20 gauge wire (minimum)

WARRANTY

Units carry a 15 year warranty on the HRV core and a 2 year replacement parts warranty.


DIMENSIONS 2000IFD-240SP inches

	A	B	C	D	E	F	G	H	I	J	L
2000	22	3.75	18	11.25	39	66.75	22	18	10.25	3.75	57.25

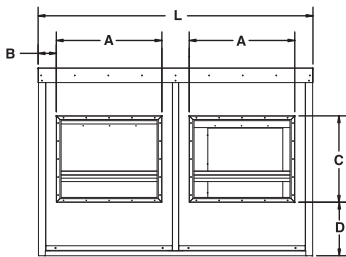


INLET END VIEW

Service Clearance 30" (both sides)

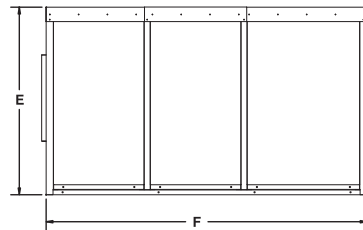

SIDE VIEW

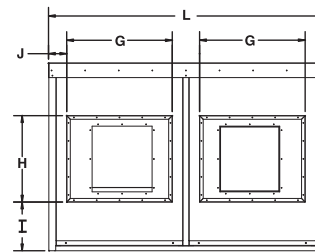

OUTLET END VIEW

All units conform to CSA and UL standards.

NOTE: All specifications are subject to change without notice.

Date: _____

Tag: _____ Qty: _____

Project: _____

Engineer: _____

Contractor: _____

Supplier: _____

Quote#: _____

Submitted by: _____